


System No. C-AJ-1673



ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating - 3 Hr	F Rating - 3 Hr
T Ratings - 0 and 1/4 Hr (See Item 2)	FT Ratings - 0 and 1/4 Hr (See Item 2)
L Rating At Ambient - Less Than 1 CFM/sq ft	FH Rating - 3 Hr
L Rating At 400 F - Less Than 1 CFM/sq ft	FTH Ratings - 0 and 1/4 Hr (See Item 2)
	L Rating At Ambient - Less Than 5.1 L/s/m2
	L Rating At 400 F - Less Than 5.1 L/s/m2

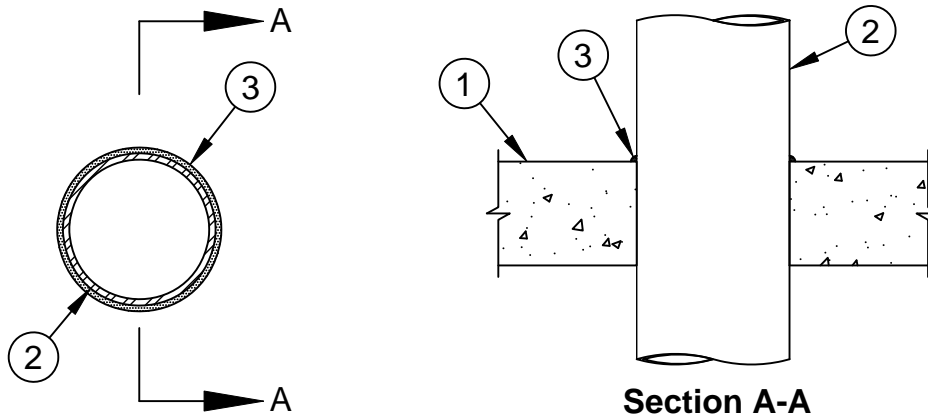

1. **Floor or Wall Assembly** - Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max diam of opening is 32 in. (813 mm).
See **Concrete Block** (CAZT) category in the Fire Resistance Directory for names of manufacturers.
2. **Through Penetrants** - One metallic pipe, conduit or tube to be installed either concentrically or eccentrically within the firestop system. The annular space between the penetrant and the periphery of the opening shall be min 0 in. (point contact) to max 2 in. (51 mm). Penetrant may be installed with continuous point contact. Penetrant to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:
 - A. **Steel Pipe** - Nom 30 in. (762 mm) diam (or smaller) Schedule 5 (or heavier) steel pipe.
 - B. **Iron Pipe** - Nom 30 in. (762 mm) diam (or smaller) cast or ductile iron pipe.
 - C. **Conduit** - Nom 4 in. (102 mm) diam (or smaller) steel electrical metallic tubing or nom 6 in. (152 mm) diam (or smaller) steel conduit.
 - D. **Copper Tubing** - Nom 6 in. (152 mm) diam (or smaller) Type L (or heavier) copper tubing.
 - E. **Copper Pipe** - Nom 6 in. (152 mm) diam (or smaller) Regular (or heavier) copper pipe.

When the penetrant is installed with continuous point contact, the T, FT and FTH Ratings are 1/4 Hr. When the penetrant is installed with annular space the T, FT, and FTH Ratings are 0 Hr.
3. **Firestop System** - The firestop system shall consist of the following:
 - A. **Packing Material** - (Optional, Not Shown) - Mineral wool batt insulation, polyethylene backer rod or glass fiber batt insulation fitted into annular space. Packing material to be recessed from top surface of floor or both surfaces of wall to accommodate the required thickness of fill material.
 - B. **Fill, Void or Cavity Material* - Caulk** - Min 1/2 in. thickness of fill material applied within the annulus, flush with top surface of floor or with both surfaces of wall. At the point contact or continuous point contact locations, apply min 1/4 in. (6mm) diam bead of sealant at the pipe/concrete interface on the top surface of the floor or both surfaces of wall.

SPECIFIED TECHNOLOGIES INC - SpecSeal Series SSS Sealant or SpecSeal LCI Sealant

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Specified Technologies Inc. 210 Evans Way Somerville, NJ 08876

Reproduced courtesy of Underwriters Laboratories, Inc.
Created or Revised: January 18, 2017

