



Series 33 Position Clamp (Part Number: EZP133PC)

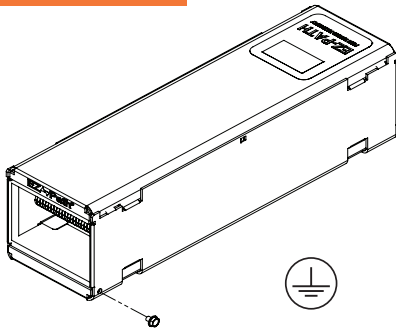


Optional Ground Attachment

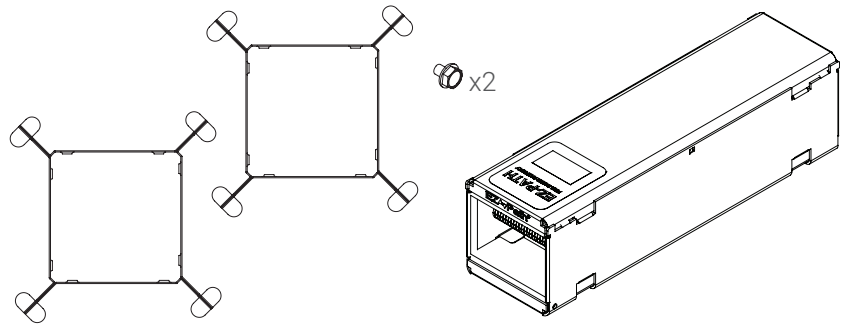


Parts Included (Not to Scale)


Old Work Installations (Cables Already Installed)

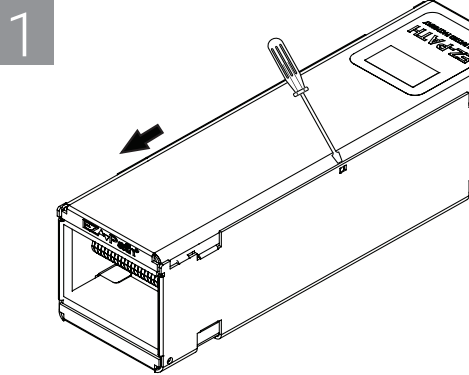


Remove lid by placing screw driver into indent on topside of device, sliding lid toward one end of device.

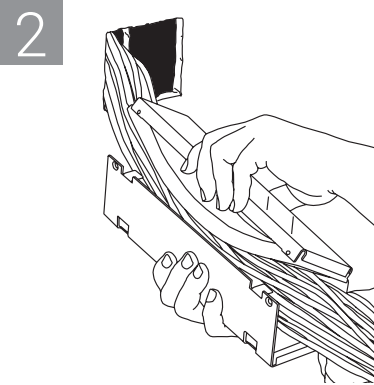

Place pathway channel around cables and reinstall device lid.

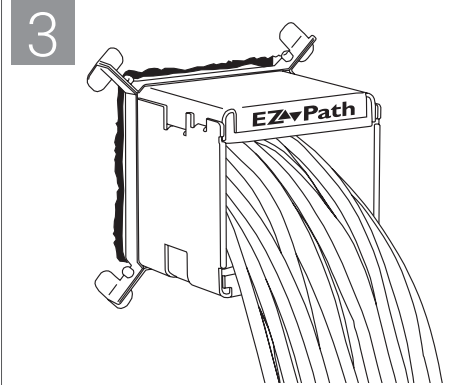

Install optional Positioning Clamp (Cat No. EZP133PC) around cable bundle and slide over pathway making sure that the flat feet of clamp are facing towards wall surface.

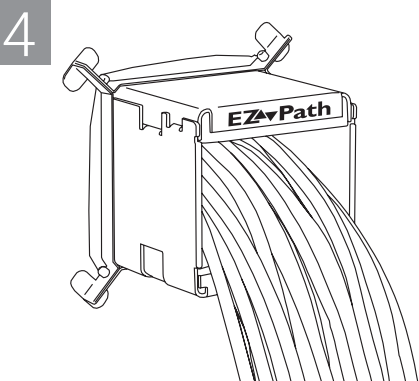

Fill annular space between device and wall with approved SpecSeal® Firestop Sealant. See UL System for more detail.

TABLE A: OPENING DIMENSIONS

Square/Rectangular	
Opening Height	3-1/8" (79 mm)
Opening Width	3-1/8" (79 mm)
Round	
Opening Diameter	4" (102 mm)

Note: For more information on firestop installation, refer to ASTM E3157.

